PFOA INVESTIGATION
Updated: April 21, 2016

Results received through 04/20/2016

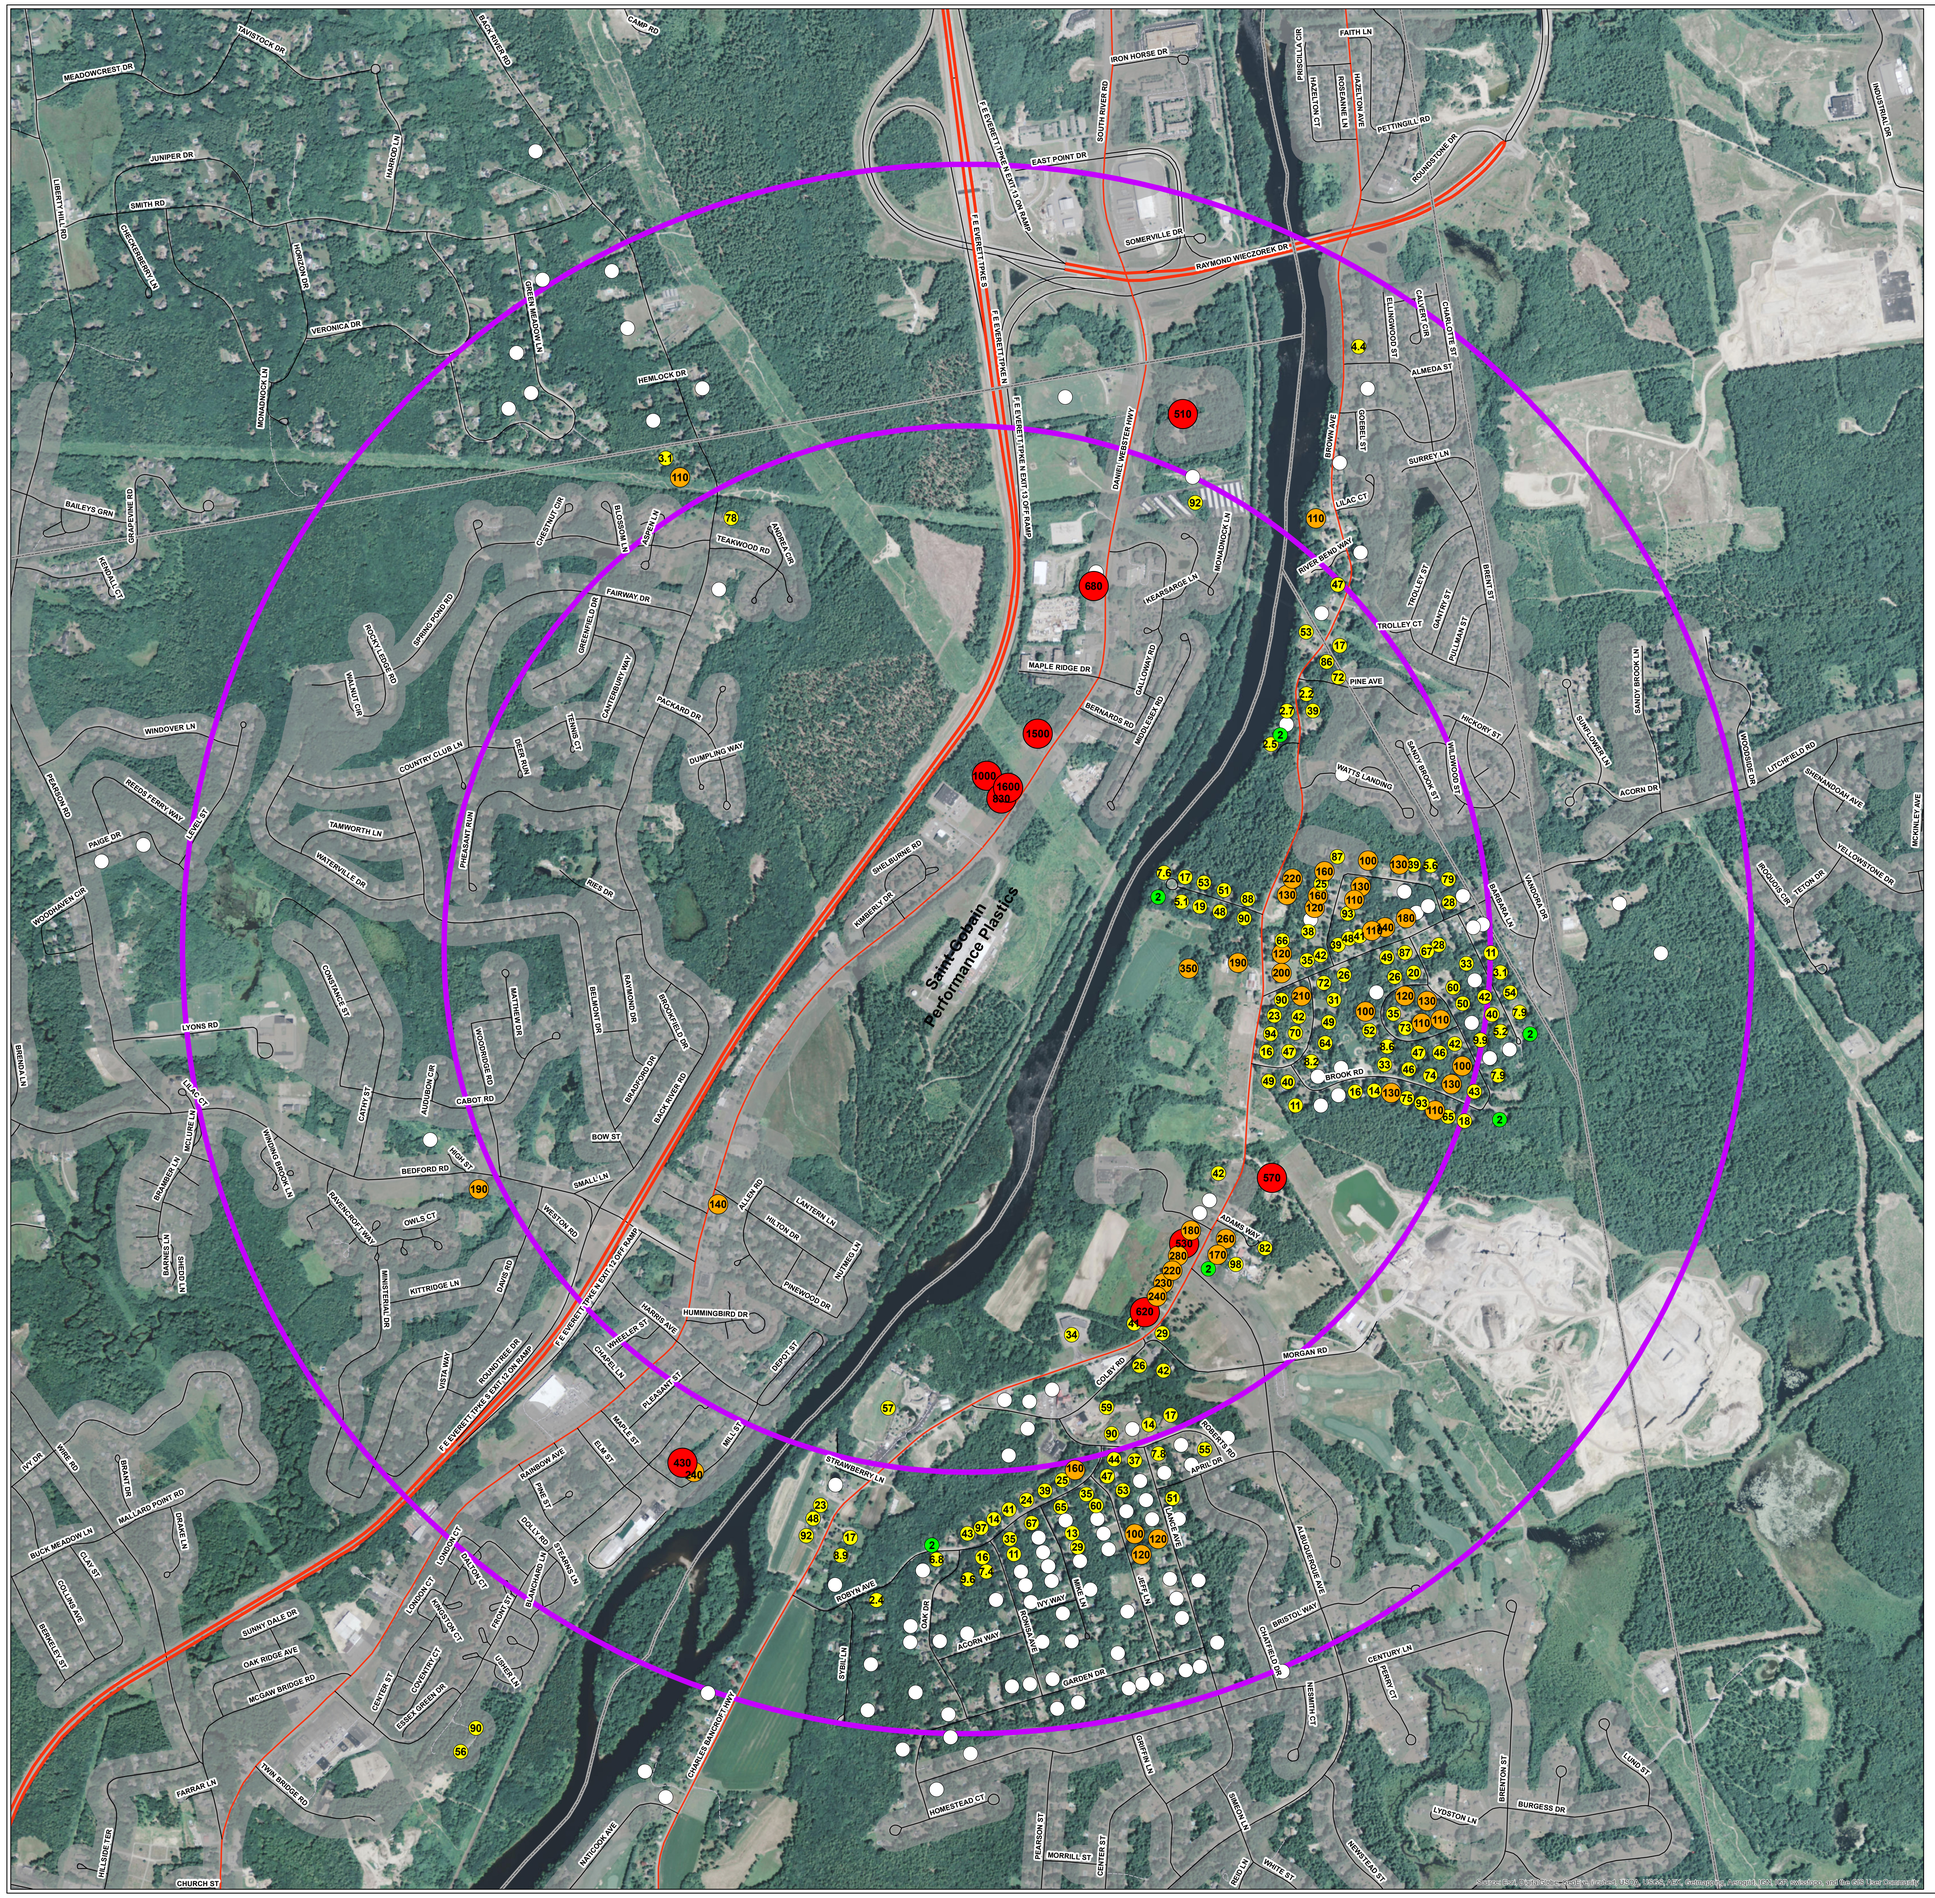

PFOA (PPT)

- ≥400
- 100-399
- <100
- Non Detect (<2)
- Result Pending

Public Water Supplies

- Water Distribution

Transportation

- US/ NH Route
- Road
- Driveway

- Political Boundary

1 Mile 0.5

Area of Investigation

1:7,800

1 in = 650 feet

N W E S

NEW HAMPSHIRE DEPARTMENT OF Environmental Services