PFOA INVESTIGATION
Updated: May 24, 2016

Results received through 05/23/2016

Most recent result shown for wells sampled on more than one occasion

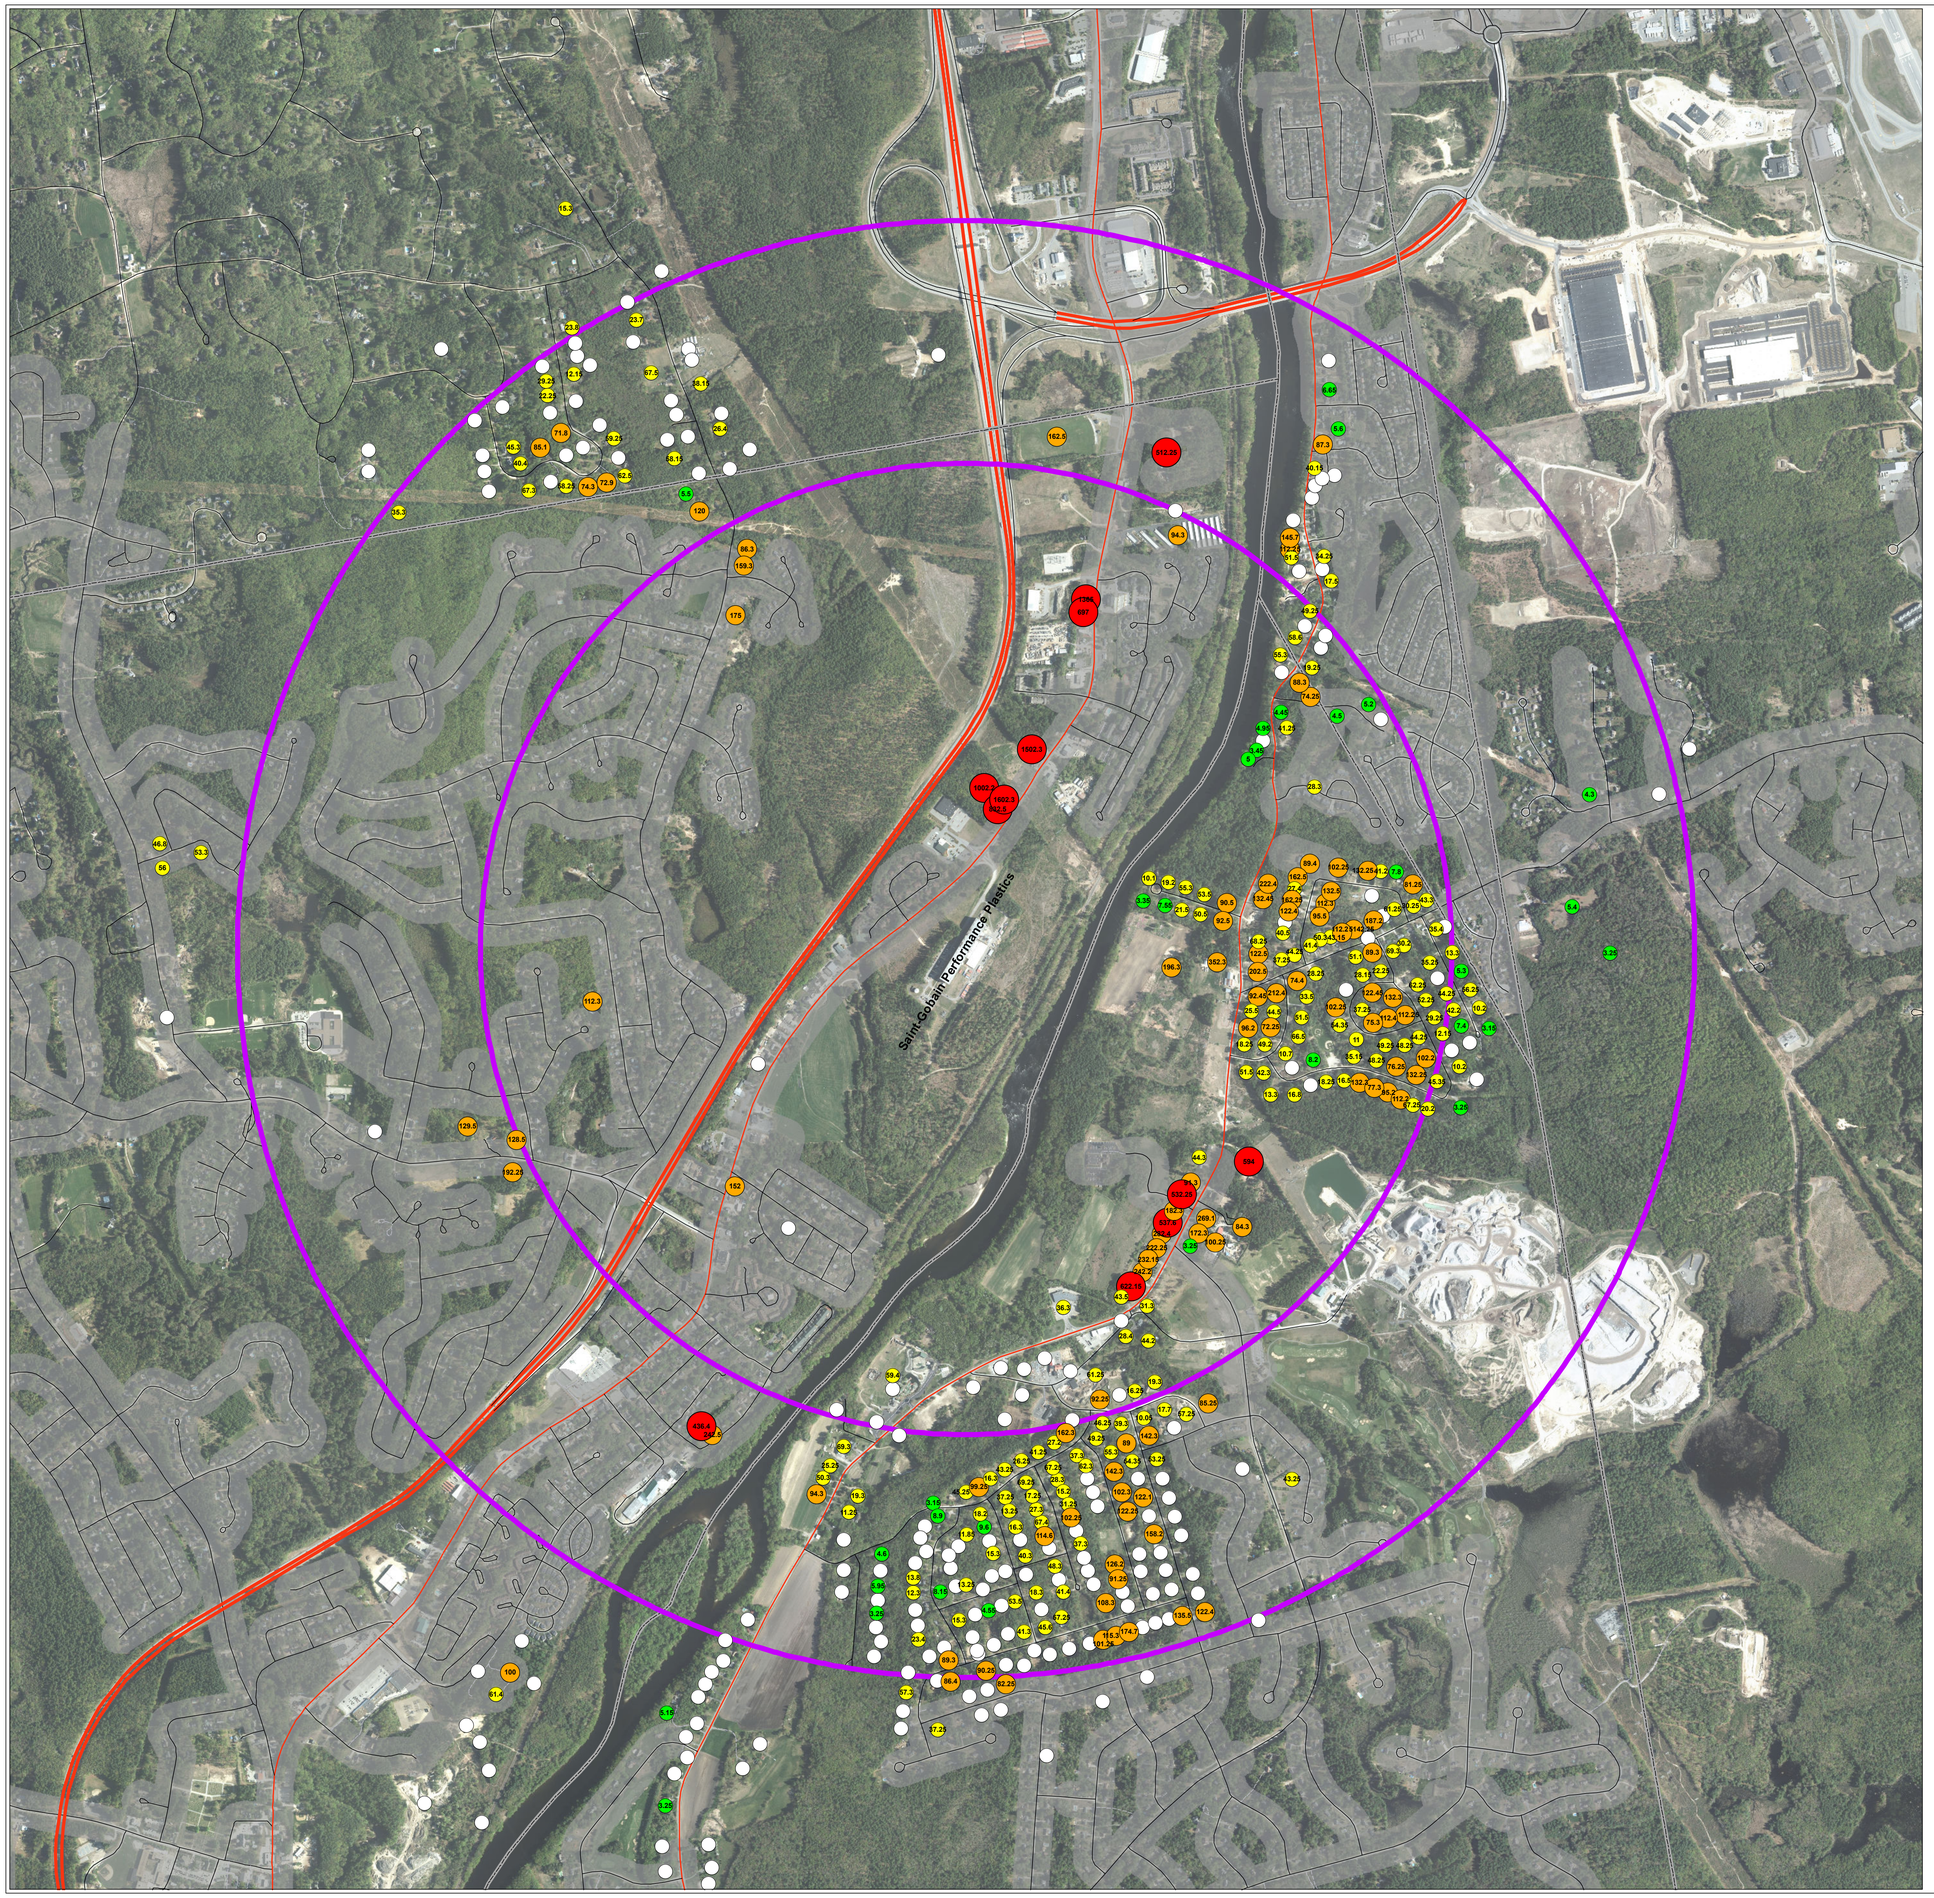

1 0.5 Mile

Area of Investigation

PFOA + PFOS (PPT)

- ≥400
- 70 - <400
- 10 - <70
- <10
- Result Pending

Public Water Supplies

- Water Distribution

Transportation

- US/ NH Route
- Road
- Driveway
- Political Boundary

1:8,400

1 in = 700 feet

N W E S

NEW HAMPSHIRE DEPARTMENT OF Environmental Services